



**DIVISION OF
ENVIRONMENTAL
QUALITY**

Sarah Huckabee Sanders
GOVERNOR

Shane E. Khoury
SECRETARY

April 9, 2025

Honorable Stephanie Orman, Mayor
City of Bentonville
1000 SW 14th St.
Bentonville, AR 72712
Email Address: sorman@bentonvillear.com

RE: City of Bentonville Inspection (Benton County) – PDS #133239
AFIN: 04-00154 Permit No.: AR0022403

Dear Mayor Orman:

On March 27, 2025, I performed a Compliance Evaluation Inspection of the above referenced facility in accordance with the provisions of the Federal Clean Water Act, the Arkansas Water and Air Pollution Control Act, and the regulations promulgated thereunder. A copy of the inspection report is enclosed for your records.

No violations were noted at the time of the inspection. Please refer to the inspection report for any comments.

If I can be of any assistance, please contact me at William.Cody@arkansas.gov or (501) 944-2569.

Sincerely,

A handwritten signature in blue ink that reads 'Will Cody'.

William Cody
Inspector, Office of Water Quality

Cc: cearl@bentonvillear.com

 ENVIRONMENTAL QUALITY	OFFICE OF WATER QUALITY INSPECTION REPORT				
	AFIN: 04-00154		PERMIT #: AR0022403		
	DATE: 3/27/2025				
	COUNTY: 04 Benton		PDS #: 133239		
GPS LAT: 36.390939		LONG: -94.203999		LOCATION: Entrance	
FACILITY INFORMATION			INSPECTION INFORMATION		
NAME: City of Bentonville LOCATION: 1901 NE A St. CITY: Bentonville			FACILITY TYPE: 1 - Municipal INSPECTOR ID#: 142257 S - State		
			FACILITY EVALUATION RATING: *** INSPECTION TYPE: Compliance Evaluation		
			DATE(S): 3/27/2025 ENTRY TIME: 09:55 EXIT TIME: 10:42 PERMIT EFFECTIVE DATE: 2/1/2021 PERMIT EXPIRATION DATE: 1/31/2026		
RESPONSIBLE OFFICIAL					
NAME / TITLE: Stephanie Orman / Mayor COMPANY: City of Bentonville MAILING ADDRESS: 1000 SW 14th St. CITY, STATE, ZIP: Bentonville AR 72712 PHONE & EXT: / FAX: 479-271-3160 / EMAIL: sorman@bentonvillear.com			FAYETTEVILLE SHALE RELATED: N FAYETTEVILLE SHALE VIOLATIONS: N		
CONTACTED DURING INSPECTION: No			INSPECTION PARTICIPANTS NAME/TITLE/PHONE/FAX/EMAIL/ETC.: Chris Earl, Manager, (479) 696-0273, cearl@bentonvillear.com William Cody, DEQ Area 1 Inspector, (501) 944-2569, William.Cody@arkansas.gov		
AREA EVALUATIONS (S=Satisfactory, M=Marginal, U=Unsatisfactory, N=Not Applicable/Evaluated)					
S	PERMIT	S	FLOW MEASUREMENT	N	STORMWATER
S	RECORDS/REPORTS	S	LABORATORY	S	FACILITY SITE REVIEW
S	OPERATION & MAINTENANCE	S	EFFLUENT/RECEIVING WATER	N	SELF-MONITORING PROGRAM
S	SAMPLING	S	SLUDGE HANDLING/DISPOSAL	N	PRETREATMENT
**	OTHER:				
SUMMARY OF FINDINGS					
No items were noted during the inspection.					

GENERAL COMMENTS

On March 27, 2025, I conducted a Compliance Evaluation Inspection at the above-referenced facility. Mr. Chris Earl, Manager at Bentonville Water Resource Recovery Facility, accompanied me during the inspection. The inspection consisted of a records review and site assessment.

Records Review:

I provided Mr. Earl the DEQ Laboratory Records Request sheet during the inspection for specific records and information to be provided to the DEQ laboratory within 5 business days of the inspection. I requested bench sheet records for February and November 2024 to conduct the DMR consistency check. The DMR consistency check revealed no items of non-compliance, and all bench sheet records provided are in very well-kept order.

Site Assessment:

The facility is well-maintained and kept in good condition overall. There are no indications of any overflows or leaks from equipment, and all treatment units appear in adequate condition. Mr. Earl informed me that over the next four years, the facility will be conducting a significant upgrade to the facility to account for population growth and expediency with an updated headworks, new clarifier(s), intensification, etc. The influent will now enter from the north side of the facility with the new headworks consisting of two automatic bar screens, manual bar screens, new grit system, and fewer components overall.

Some of the current tanks/clarifiers will be decommissioned but saved for future potential use. Selective wasting will be implemented in the oxidation ditches with the new upgrade – baffles will be stalled roughly 1.5” into the water for this system. Impeller pumps will replace all recycle pumps at the facility. In the anoxic basin, four new anoxic zones will be built, and the submersible mixers will be pulled to be replaced with a bubbling system to be installed at the bottom of the basins in a grid. The facility will also implement a blending unit for short-term treatment, primarily for rainwater that does not need to go through full treatment. The current UV disinfection system will be replaced with an updated, more automatic UV disinfectant system. With the upgrade, the facility will also get two generators to power different ends of the facility. The facility upgrade will start in June 2025 and take approximately 4.5 years to complete.

There were no items of significance noted during the inspection. Mr. Earl pointed out that one clarifier is not level and therefore the water flows over most, but not all, weirs (see photo). It was explained that the facility still meets effluent requirements and has seen no water quality concerns due to this.

INSPECTOR'S SIGNATURE:  William Cody	DATE: 4/2/2025
SUPERVISOR'S SIGNATURE:  Amy Huneycutt	DATE: 4/4/2025

SECTION A: PERMIT VERIFICATION

PERMIT SATISFACTORILY ADDRESSES OBSERVATIONS ☒S ☐M ☐U ☐NA ☐NE

DETAILS:

- | | |
|--|--|
| 1. CORRECT NAME AND MAILING ADDRESS OF PERMITTEE: | ☒ Y ☐ N ☐ NA ☐ NE |
| 2. NOTIFICATION GIVEN TO EPA/STATE OF NEW DIFFERENT OR INCREASED DISCHARGES: | ☒ Y ☐ N ☐ NA ☐ NE |
| 3. NUMBER AND LOCATION OF DISCHARGE POINTS AS DESCRIBED IN PERMIT: | ☒ Y ☐ N ☐ NA ☐ NE |
| 4. ALL DISCHARGES ARE PERMITTED: | ☒ Y ☐ N ☐ NA ☐ NE |

SECTION B: RECORDKEEPING AND REPORTING EVALUATION

RECORDS AND REPORTS MAINTAINED AS REQUIRED BY PERMIT ☒S ☐M ☐U ☐NA ☐NE

DETAILS:

- | | |
|--|---|
| 1. ANALYTICAL RESULTS CONSISTENT WITH DATA REPORTED ON DMRS: | ☒ Y ☐ N ☐ NA ☐ NE |
| 2. SAMPLING AND ANALYSES DATA ADEQUATE AND INCLUDE: | ☒ S ☐ M ☐ U ☐ NA ☐ NE |
| a. DATES AND TIME(S) OF SAMPLING: | ☒ Y ☐ N ☐ NA ☐ NE |
| b. EXACT LOCATION(S) OF SAMPLING: | ☒ Y ☐ N ☐ NA ☐ NE |
| c. NAME OF INDIVIDUAL PERFORMING SAMPLING: | ☒ Y ☐ N ☐ NA ☐ NE |
| d. ANALYTICAL METHODS AND TECHNIQUES: | ☒ Y ☐ N ☐ NA ☐ NE |
| e. RESULTS OF CALIBRATIONS: | ☒ Y ☐ N ☐ NA ☐ NE |
| f. RESULTS OF ANALYSES: | ☒ Y ☐ N ☐ NA ☐ NE |
| g. DATES AND TIMES OF ANALYSES: | ☒ Y ☐ N ☐ NA ☐ NE |
| h. NAME OF PERSON(S) PERFORMING ANALYSES: | ☒ Y ☐ N ☐ NA ☐ NE |
| 3. LABORATORY EQUIPMENT CALIBRATION AND MAINTENANCE RECORDS ADEQUATE: | ☒ S ☐ M ☐ U ☐ NA ☐ NE |
| 4. PLANT RECORDS INCLUDE SCHEDULES, DATES OF EQUIPMENT MAINTENANCE AND REPAIR: | ☒ S ☐ M ☐ U ☐ NA ☐ NE |
| 5. EFFLUENT LOADINGS CALCULATED USING DAILY EFFLUENT FLOW AND DAILY ANALYTICAL DATA: | ☒ Y ☐ N ☐ NA ☐ NE |

SECTION C: OPERATIONS AND MAINTENANCE

TREATMENT FACILITY PROPERLY OPERATED AND MAINTAINED ☒S ☐M ☐U ☐NA ☐NE

DETAILS:

- | | |
|---|---|
| 1. TREATMENT UNITS PROPERLY OPERATED: | ☒ S ☐ M ☐ U ☐ NA ☐ NE |
| 2. TREATMENT UNITS PROPERLY MAINTAINED: | ☒ S ☐ M ☐ U ☐ NA ☐ NE |
| 3. STANDBY POWER OR OTHER EQUIVALENT PROVIDED: | ☒ S ☐ M ☐ U ☐ NA ☐ NE |
| 4. ADEQUATE ALARM SYSTEM FOR POWER OR EQUIPMENT FAILURES AVAILABLE: | ☒ S ☐ M ☐ U ☐ NA ☐ NE |
| 5. ALL NEEDED TREATMENT UNITS IN SERVICE: | ☒ S ☐ M ☐ U ☐ NA ☐ NE |
| 6. ADEQUATE NUMBER OF QUALIFIED OPERATORS PROVIDED: | ☒ S ☐ M ☐ U ☐ NA ☐ NE |
| 7. SPARE PARTS AND SUPPLIES INVENTORY MAINTAINED: | ☒ S ☐ M ☐ U ☐ NA ☐ NE |
| 8. OPERATION AND MAINTENANCE MANUAL AVAILABLE: | ☒ Y ☐ N ☐ NA ☐ NE |
| 9. STANDARD OPERATING PROCEDURES AND SCHEDULES ESTABLISHED: | ☒ Y ☐ N ☐ NA ☐ NE |
| 10. PROCEDURES FOR EMERGENCY TREATMENT CONTROL ESTABLISHED: | ☒ Y ☐ N ☐ NA ☐ NE |
| 11. HAVE BYPASSES/OVERFLOWS OCCURRED AT THE PLANT OR IN THE COLLECTION SYSTEM IN THE LAST YEAR: | ☐ Y ☒ N ☐ NA ☐ NE |
| 12. IF SO, HAS THE REGULATORY AGENCY BEEN NOTIFIED: | ☐ Y ☐ N ☒ NA ☐ NE |
| 13. HAS CORRECTIVE ACTION BEEN TAKEN TO PREVENT ADDITIONAL BYPASSES/OVERFLOWS: | ☒ Y ☐ N ☐ NA ☐ NE |
| 14. HAVE ANY HYDRAULIC OVERLOADS OCCURRED AT THE TREATMENT PLANT: | ☐ Y ☒ N ☐ NA ☐ NE |
| 15. IF SO, DID PERMIT VIOLATIONS OCCUR AS A RESULT: | ☐ Y ☐ N ☒ NA ☐ NE |

SECTION D: SAMPLING	
PERMITTEE SAMPLING MEETS PERMIT REQUIREMENTS	☒ S ☐ M ☐ U ☐ NA ☐ NE
DETAILS:	
1. SAMPLES TAKEN AT SITE(S) SPECIFIED IN PERMIT:	☒ Y ☐ N ☐ NA ☐ NE
2. LOCATIONS ADEQUATE FOR REPRESENTATIVE SAMPLES:	☒ Y ☐ N ☐ NA ☐ NE
3. FLOW PROPORTIONED SAMPLES OBTAINED WHEN REQUIRED BY PERMIT:	☒ Y ☐ N ☐ NA ☐ NE
4. SAMPLING AND ANALYSES COMPLETED ON PARAMETERS SPECIFIED IN PERMIT:	☒ Y ☐ N ☐ NA ☐ NE
5. SAMPLING AND ANALYSES PERFORMED AT FREQUENCY SPECIFIED IN PERMIT:	☒ Y ☐ N ☐ NA ☐ NE
6. SAMPLE COLLECTION PROCEDURES ADEQUATE:	☒ Y ☐ N ☐ NA ☐ NE
a. SAMPLES REFRIGERATED DURING COMPOSITING:	☒ Y ☐ N ☐ NA ☐ NE
b. PROPER PRESERVATION TECHNIQUES USED:	☒ Y ☐ N ☐ NA ☐ NE
c. CONTAINERS AND SAMPLE HOLDING TIMES CONFORM TO 40 CFR 136:	☒ Y ☐ N ☐ NA ☐ NE
7. IF MONITORING IS PERFORMED MORE OFTEN THAN REQUIRED ARE RESULTS REPORTED ON THE DMR:	☐ Y ☐ N ☐ NA ☒ NE
SECTION E: FLOW MEASUREMENT	
PERMITTEE FLOW MEASUREMENT MEETS PERMIT REQUIREMENTS	☒ S ☐ M ☐ U ☐ NA ☐ NE
DETAILS:	
1. PRIMARY FLOW MEASUREMENT DEVICE PROPERLY INSTALLED AND MAINTAINED: <u>18" Parshall flume</u> TYPE OF DEVICE:	☒ Y ☐ N ☐ NA ☐ NE
2. FLOW MEASURED AT EACH OUTFALL AS REQUIRED:	☒ Y ☐ N ☐ NA ☐ NE
3. SECONDARY INSTRUMENTS (TOTALIZERS, RECORDERS, ETC.) PROPERLY OPERATED AND MAINTAINED:	☒ Y ☐ N ☐ NA ☐ NE
4. CALIBRATION FREQUENCY ADEQUATE:	☒ Y ☐ N ☐ NA ☐ NE
5. RECORDS MAINTAINED OF CALIBRATION PROCEDURES:	☒ Y ☐ N ☐ NA ☐ NE
6. CALIBRATION CHECKS DONE TO ASSURE CONTINUED COMPLIANCE:	☒ Y ☐ N ☐ NA ☐ NE
7. FLOW ENTERING DEVICE WELL DISTRIBUTED ACROSS THE CHANNEL AND FREE OF TURBULENCE:	☒ Y ☐ N ☐ NA ☐ NE
8. FLOW MEASUREMENT EQUIPMENT ADEQUATE TO HANDLE EXPECTED RANGE OF FLOW RATES:	☒ Y ☐ N ☐ NA ☐ NE
9. HEAD MEASURED AT PROPER LOCATION:	☒ Y ☐ N ☐ NA ☐ NE
SECTION F: LABORATORY	
PERMITTEE LABORATORY PROCEDURES MEET PERMIT REQUIREMENTS	☒ S ☐ M ☐ U ☐ NA ☐ NE
DETAILS:	
1. EPA APPROVED ANALYTICAL PROCEDURES USED (40 CFR 136.3 FOR LIQUIDS, 503.8(B) FOR SLUDGES) :	☒ Y ☐ N ☐ NA ☐ NE
2. IF ALTERNATIVE ANALYTICAL PROCEDURES ARE USED, PROPER APPROVAL HAS BEEN OBTAINED:	☐ Y ☐ N ☐ NA ☒ NE
3. SATISFACTORY CALIBRATION AND MAINTENANCE OF INSTRUMENTS AND EQUIPMENT:	☒ Y ☐ N ☐ NA ☐ NE
4. QUALITY CONTROL PROCEDURES ADEQUATE:	☒ Y ☐ N ☐ NA ☐ NE
5. DUPLICATE SAMPLES ARE ANALYZED $\geq 10\%$ OF THE TIME:	☒ Y ☐ N ☐ NA ☐ NE
6. SPIKED SAMPLES ARE ANALYZED $\geq 10\%$ OF THE TIME:	☒ Y ☐ N ☐ NA ☐ NE
7. COMMERCIAL LABORATORY USED:	☐ Y ☐ N ☐ NA ☒ NE
a. LAB NAME:	
b. LAB ADDRESS:	
c. PARAMETERS PERFORMED:	
8. BIOMONITORING PROCEDURES ADEQUATE:	☐ Y ☐ N ☐ NA ☒ NE
a. PROPER ORGANISMS USED:	☐ Y ☐ N ☐ NA ☒ NE
b. PROPER DILUTION SERIES FOLLOWED:	☐ Y ☐ N ☐ NA ☒ NE
c. PROPER TEST METHODS AND DURATION:	☐ Y ☐ N ☐ NA ☒ NE
d. RETESTS AND/OR TRE PERFORMED AS REQUIRED:	☐ Y ☐ N ☐ NA ☒ NE

SECTION G: EFFLUENT/RECEIVING WATERS OBSERVATIONS							
BASED ON VISUAL OBSERVATIONS ONLY						☐ S ☐ M ☐ U ☐ NA ☐ NE	
DETAILS:							
OUTFALL #:	OIL SHEEN	GREASE	TURBIDITY	VISIBLE FOAM	FLOATING SOLIDS	COLOR	OTHER
001	None	None	None	None	None	Clear	--
SECTION H: SLUDGE DISPOSAL							
SLUDGE DISPOSAL MEETS PERMIT REQUIREMENTS						☒ S ☐ M ☐ U ☐ NA ☐ NE	
DETAILS:							
1. SLUDGE MANAGEMENT ADEQUATE TO MAINTAIN EFFLUENT QUALITY:						☒ S ☐ M ☐ U ☐ NA ☐ NE	
2. SLUDGE RECORDS MAINTAINED AS REQUIRED BY 40 CFR 503:						☒ S ☐ M ☐ U ☐ NA ☐ NE	
3. FOR LAND APPLIED SLUDGE, TYPE OF LAND APPLIED TO: (E.G., FOREST, AGRICULTURAL, PUBLIC CONTACT SITE):							
SECTION I: SAMPLING INSPECTION PROCEDURES							
SAMPLE RESULTS WITHIN PERMIT REQUIREMENTS						☐ S ☐ M ☐ U ☒ NA ☐ NE	
DETAILS:							
1. SAMPLES OBTAINED THIS INSPECTION:						☐ Y ☐ N ☒ NA ☐ NE	
2. TYPE OF SAMPLE: ☐ GRAB:___ ☐ COMPOSITE:___ METHOD:___ FREQUENCY:___							
3. SAMPLES PRESERVED:						☐ Y ☐ N ☒ NA ☐ NE	
4. FLOW PROPORTIONED SAMPLES OBTAINED:						☐ Y ☐ N ☒ NA ☐ NE	
5. SAMPLE OBTAINED FROM FACILITY'S SAMPLING DEVICE:						☐ Y ☐ N ☒ NA ☐ NE	
6. SAMPLE REPRESENTATIVE OF VOLUME AND NATURE OF DISCHARGE:						☐ Y ☐ N ☒ NA ☐ NE	
7. SAMPLE SPLIT WITH PERMITTEE:						☐ Y ☐ N ☒ NA ☐ NE	
8. CHAIN-OF-CUSTODY PROCEDURES EMPLOYED:						☐ Y ☐ N ☒ NA ☐ NE	
9. SAMPLES COLLECTED IN ACCORDANCE WITH PERMIT:						☐ Y ☐ N ☒ NA ☐ NE	
SECTION J: STORM WATER POLLUTION PREVENTION PLAN							
STORM WATER MANAGEMENT MEETS PERMIT REQUIREMENTS						☐ S ☐ M ☐ U ☐ NA ☒ NE	
DETAILS:							
1. SWPPP UPDATED AS NEEDED:___ DATE OF LAST UPDATE:___						☐ Y ☐ N ☐ NA ☒ NE	
2. SITE MAP INCLUDING ALL DISCHARGES AND SURFACE WATERS:						☐ Y ☐ N ☐ NA ☒ NE	
3. POLLUTION PREVENTION TEAM IDENTIFIED:						☐ Y ☐ N ☐ NA ☒ NE	
4. POLLUTION PREVENTION TEAM PROPERLY TRAINED:						☐ Y ☐ N ☐ NA ☒ NE	
5. LIST OF POTENTIAL POLLUTANT SOURCES:						☐ Y ☐ N ☐ NA ☒ NE	
6. LIST OF POTENTIAL SOURCES AND PAST SPILLS AND LEAKS:						☐ Y ☐ N ☐ NA ☒ NE	
7. ALL NON-STORM WATER DISCHARGES ARE AUTHORIZED:						☐ Y ☐ N ☐ NA ☒ NE	
8. LIST OF STRUCTURAL BMPS:						☐ Y ☐ N ☐ NA ☒ NE	
9. LIST OF NON-STRUCTURAL BMPS:						☐ Y ☐ N ☐ NA ☒ NE	
10. BMPS PROPERLY OPERATED AND MAINTAINED:						☐ Y ☐ N ☐ NA ☒ NE	
11. INSPECTIONS CONDUCTED AS REQUIRED:						☐ Y ☐ N ☐ NA ☒ NE	

FLOW CALCULATION SHEET

Date: 3/27/2025					Time: 10.30			
Head in Inches: 8.748		Feet: 0.728						
Type & Size of Primary Flow Measurement Device: 18" Parshall Flume								
Name & Model of Secondary Flow Measurement Device: ISCO 310								
Date of last Calibration of Secondary Flow Device:							3/4/2025	
Recorded Flow at Date & Time Listed Above:							(Facility Flow Meter)	
Calculated Flow at Date & Time Listed Above:					2.390			
(Flow is calculated using flow charts in: ISCO Open Channel Flow Measurement Handbook-5 th Edition)								
% Error =	Recorded Value	-	Calculated Value	X 100				
	Calculated Value							
% Error =		-		X 100				
% Error =			X 100					
% Error =			X 100					
% Error =		%						
Comments:	<u>Recorded Flow at Date & Time during inspection was not noted. The 6/13/2023 inspection report suggests an estimated flow of 2.340 MGD at a similar time; however, estimated flow numbers will not be used in this Flow Calculation Sheet in order to avoid calculating an incorrect/improper error percentage. Site conditions, calibration date of secondary flow device, and flow suggests the error percentage is well within +- 10% deviation.</u>							

DMR Calculation Check

Reporting Period:	From	<u>2024</u>	<u>02</u>	<u>01</u>	To	<u>2024</u>	<u>02</u>	<u>29</u>
		Year	Month	Day		Year	Month	Day

Parameter Checked: TSS

	Loading Mass Mo. Avg. - lbs/day	Concentration Monthly Mo. Avg. - mg/l	7-day Avg. - mg/l
Reported Value:	<u>113.7</u>	<u>4.3</u>	<u>7.1</u>
Calculated Value:	<u>113.7</u>	<u>4.3</u>	<u>7.1</u>
Permit Value:	500.0	15.0	22.5

If calculated value does not equal reported value, explain:

DMR Calculation Check

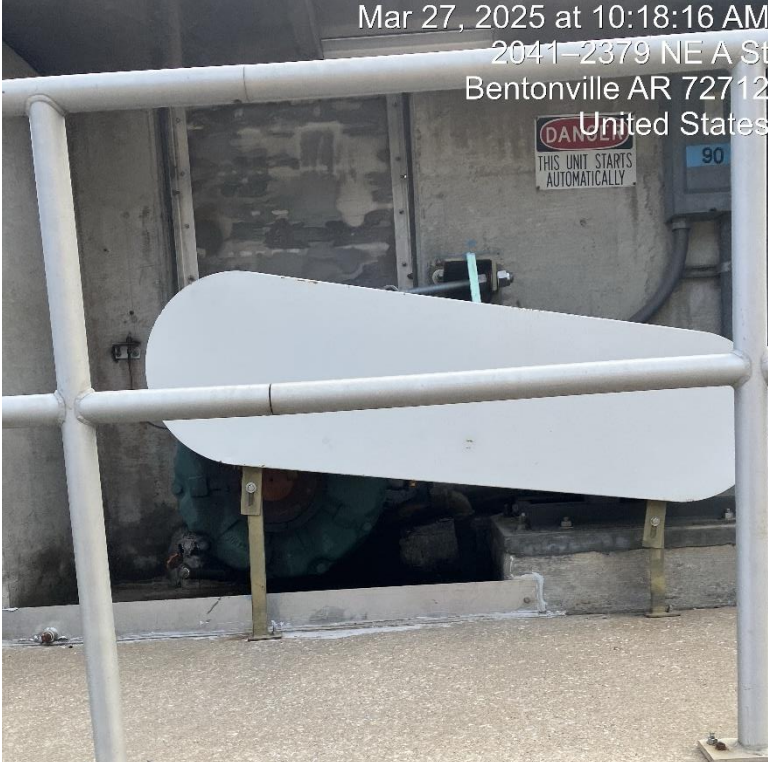
Reporting Period:	From	<u>2024</u>	<u>11</u>	<u>01</u>	To	<u>2024</u>	<u>11</u>	<u>30</u>
		Year	Month	Day		Year	Month	Day

Parameter Checked: CBOD5

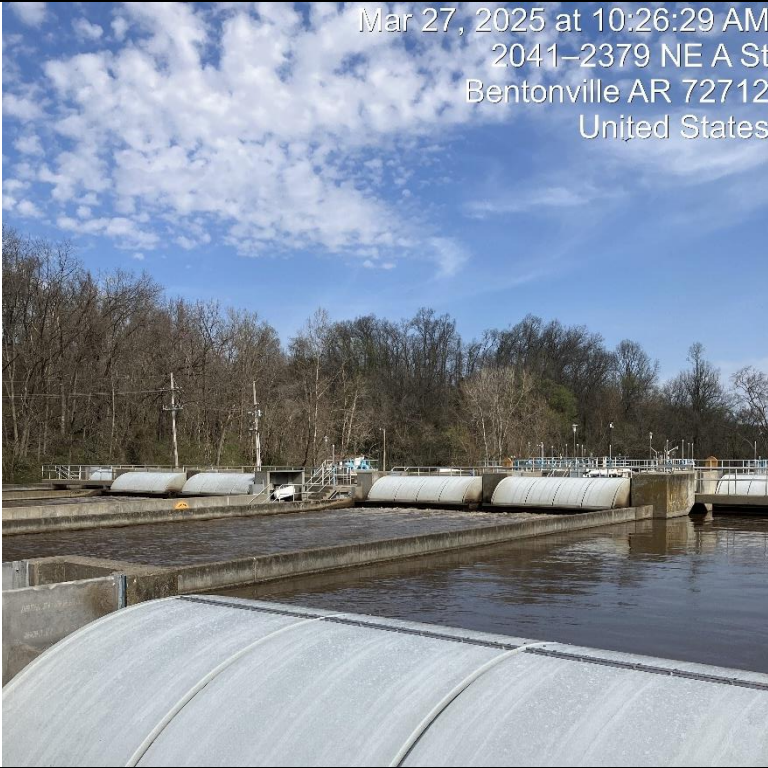
	Loading Mass Mo. Avg. - lbs/day	Concentration Monthly Mo. Avg. - mg/l	7-day Avg. - mg/l
Reported Value:	<u><71.1</u>	<u><2.0</u>	<u>2.1</u>
Calculated Value:	<u><71.1</u>	<u><2.0</u>	<u>2.1</u>
Permit Value:	333.6	10	15

If calculated value does not equal reported value, explain:

Office of Water Quality Photographic Evidence Sheet			
Location:	City of Bentonville		
Photographer:	William Cody	Date:	3/27/2025
Witness:	Chris Earl	Time:	10:09
Photo #:	1		
Description:	Automatic bar screen at headworks.		
Mar 27, 2025 at 10:09:30 AM 36 Holly Dr Bentonville AR 72712 United States 			
Photographer:	William Cody	Date:	3/27/2025
Witness:	Chris Earl	Time:	10:10
Photo #:	2		
Description:	This primary clarifier will be decommissioned as part of the upgrade.		
Mar 27, 2025 at 10:10:53 AM 36 Holly Dr Bentonville AR 72712 United States 			

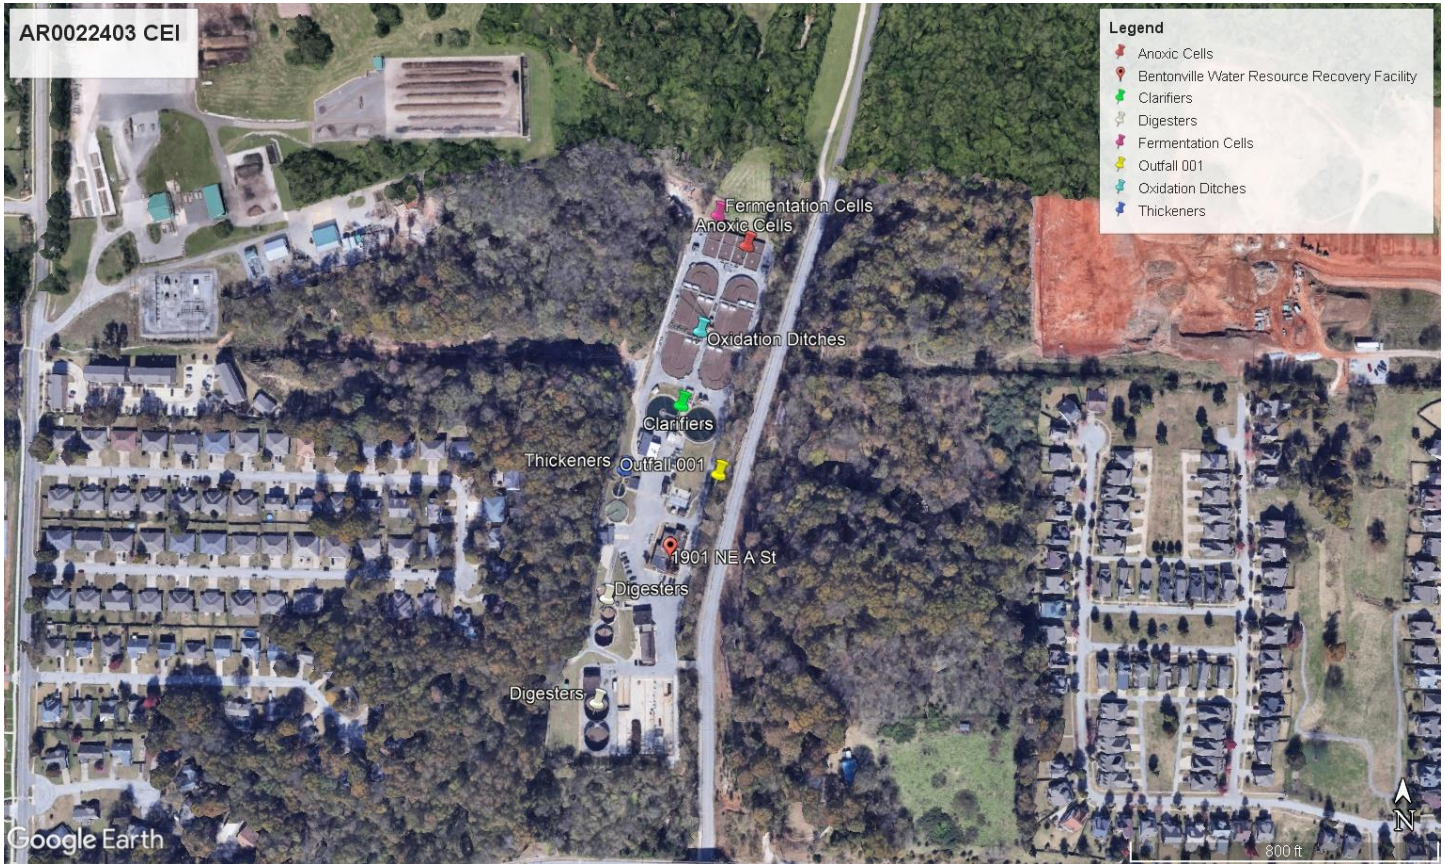
Office of Water Quality Photographic Evidence Sheet			
Location:	City of Bentonville		
Photographer:	William Cody	Date:	3/27/2025
Witness:	Chris Earl	Time:	10:14
Photo #:	3		
Description:	Secondary clarifier in good condition.		
Mar 27, 2025 at 10:14:18 AM Bentonville AR 72712 United States 			
Photographer:	William Cody	Date:	3/27/2025
Witness:	Chris Earl	Time:	10:18
Photo #:	4		
Description:	Oxidation ditches received upgraded motors for the rollers.		
Mar 27, 2025 at 10:18:16 AM 2041-2379 NE A St Bentonville AR 72712 United States 			

Office of Water Quality Photographic Evidence Sheet			
Location:	City of Bentonville		
Photographer:	William Cody	Date:	3/27/2025
Witness:	Chris Earl	Time:	10:19
Description:	Anoxic basin will receive a bubbler system to replace the submersible mixers.		
Mar 27, 2025 at 10:19:25 AM 2041-2379 NE A St Bentonville AR 72712 United States 			
Photographer:	William Cody	Date:	3/27/2025
Witness:	Chris Earl	Time:	10:26
Description:	Oxidation ditch with good mixing and coloration.		
Mar 27, 2025 at 10:26:07 AM 2041-2379 NE A St Bentonville AR 72712 United States 			

Office of Water Quality Photographic Evidence Sheet			
Location:	City of Bentonville		
Photographer:	William Cody	Date:	3/27/2025
Witness:	Chris Earl	Time:	10:26
		Photo #:	7
Description:	All rollers in the oxidation ditches are properly covered.		
Mar 27, 2025 at 10:26:29 AM 2041-2379 NE A St Bentonville AR 72712 United States 			
Photographer:	William Cody	Date:	3/27/2025
Witness:	Chris Earl	Time:	10:30
		Photo #:	8
Description:	Effluent Parshall flume and flow measurement location.		
Mar 27, 2025 at 10:30:54 AM 1901 NE A St Bentonville AR 72712 United States 			

Office of Water Quality Photographic Evidence Sheet			
Location:	City of Bentonville		
Photographer:	William Cody	Date:	3/27/2025
Witness:	Chris Earl	Time:	10:28
Photo #:	9		
Description:	Outfall 001.		
	Mar 27, 2025 at 10:28:55 AM 1901 NE A St Bentonville AR 72712 United States 		
Photographer:	William Cody	Date:	3/27/2025
Witness:	Chris Earl	Time:	10:36
Photo #:	10		
Description:	One sludge digester.		
	Mar 27, 2025 at 10:36:15 AM Bentonville AR 72712 United States 		

Office of Water Quality Photographic Evidence Sheet			
Location:	City of Bentonville		
Photographer:	William Cody	Date:	3/27/2025
Witness:	Chris Earl	Time:	10:39
		Photo #:	11
Description:	Volute Dewatering Press – was not in use during the inspection – in good condition.		
Mar 27, 2025 at 10:39:58 AM 1901 NE A St Bentonville AR 72712 United States 			



Attachment 1. Google Earth satellite imagery with indication of general treatment units at the Bentonville Water Resource Recovery Facility.