



**DIVISION OF
ENVIRONMENTAL
QUALITY**

Sarah Huckabee Sanders
GOVERNOR

Shane E. Khoury
SECRETARY

November 5, 2025

Brett Bradford, General Manager & CEO
Paragould Municipal Utilities
P.O. Box 9
Paragould, AR 72451

RE: Paragould Municipal Utilities Inspection PDS# 133494 & 133495 (Greene Co.)
AFIN: 28-00470 Permit No.: AR0033766

Dear Mr. Bradford:

On May 22, 2025, I performed a Compliance Evaluation Inspection and an SSO/Collection System Inspection of the above referenced facility in accordance with the provisions of the Federal Clean Water Act, the Arkansas Water and Air Pollution Control Act, and the regulations promulgated thereunder. Copies of the inspection reports are enclosed for your records.

No violations were noted at the time of the inspections. Please refer to the inspection report for any comments.

If I can be of any assistance, please contact me at Sarah.Frasher@arkansas.gov or 501-837-2072.

Sincerely,


A handwritten signature in black ink, appearing to read "Sarah Frasher".

Sarah Frasher
Inspector, Office of Water Quality

Cc: David Romine, PMU WWTP Operations Manager, Cognizant Official, dromine@paragould.com

 ENVIRONMENTAL QUALITY	OFFICE OF WATER QUALITY INSPECTION REPORT		
	AFIN: 28-00470 PERMIT #: AR0033766		DATE: 5/22/2025
	COUNTY: 28 Greene	PDS #: 133494	MEDIA: WN
	GPS LAT: 36.031510 LONG: -90.491631 LOCATION: Entrance		
FACILITY INFORMATION		INSPECTION INFORMATION	
NAME: Paragould Municipal Utilities LOCATION: 401 Grant Lane CITY: Paragould		FACILITY TYPE: 1 - Municipal INSPECTOR ID#: 112347 S - State FACILITY EVALUATION RATING: 4 - Satisfactory INSPECTION TYPE: Compliance Evaluation DATE(S): 5/22/2025 ENTRY TIME: 09:45 EXIT TIME: 15:06 PERMIT EFFECTIVE DATE: 3/1/2021 PERMIT EXPIRATION DATE: 2/28/2026	
RESPONSIBLE OFFICIAL			
NAME / TITLE: Brett Bradford / General Manager & CEO COMPANY: Paragould Municipal Utilities MAILING ADDRESS: P.O. Box 9 CITY, STATE, ZIP: Paragould AR 72451 PHONE & EXT: / FAX: / EMAIL: brettb@paragould.com CONTACTED DURING INSPECTION: Yes		FAYETTEVILLE SHALE RELATED: N FAYETTEVILLE SHALE VIOLATIONS: N INSPECTION PARTICIPANTS NAME/TITLE/PHONE/FAX/EMAIL/ETC.: David Romine, P.E., WWTP Operations Manager Tiffani Newsom, Laboratory Supervisor Harry Symons, Chief Operator Craig Gross, Water/Sewer Department Manager	
AREA EVALUATIONS (S=Satisfactory, M=Marginal, U=Unsatisfactory, N=Not Applicable/Evaluated)			
S	PERMIT	S	FLOW MEASUREMENT
S	RECORDS/REPORTS	S	LABORATORY
S	OPERATION & MAINTENANCE	S	EFFLUENT/RECEIVING WATER
S	SAMPLING	S	SLUDGE HANDLING/DISPOSAL
N	OTHER:	N	STORMWATER
		S	FACILITY SITE REVIEW
		S	SELF-MONITORING PROGRAM
		N	PRETREATMENT

SUMMARY OF FINDINGS
No violations were noted during the inspection.
GENERAL COMMENTS
A newly constructed headworks has been added to the treatment system (Photos 1-5). This headworks has helped the facility not only collect more grit than the previous system (Photo 4) but also is a huge asset to the overall treatment of wastewater. This facility is planning on adding another aeration basin for potential industrial and population growth for the City of Paragould. Walter Kincade and Sarah Harrod, DEQ Inspectors, also participated in this inspection. An SSO/Collection System Inspection was also performed in conjunction with this inspection. Please view PDS 133495 for more details.

INSPECTOR'S SIGNATURE:  Sarah Frasher	DATE: 7/11/2025
SUPERVISOR'S SIGNATURE:  Brent L. Walker	DATE: 10/31/2025

SECTION A: PERMIT VERIFICATION

PERMIT SATISFACTORILY ADDRESSES OBSERVATIONS ☒S ☐M ☐U ☐NA ☐NE

DETAILS:

1. CORRECT NAME AND MAILING ADDRESS OF PERMITTEE: ☒Y ☐N ☐NA ☐NE

2. NOTIFICATION GIVEN TO EPA/STATE OF NEW DIFFERENT OR INCREASED DISCHARGES: ☒Y ☐N ☐NA ☐NE

3. NUMBER AND LOCATION OF DISCHARGE POINTS AS DESCRIBED IN PERMIT: ☐Y ☐N ☒NA ☐NE

4. ALL DISCHARGES ARE PERMITTED: ☒Y ☐N ☐NA ☐NE

SECTION B: RECORDKEEPING AND REPORTING EVALUATION

RECORDS AND REPORTS MAINTAINED AS REQUIRED BY PERMIT ☒S ☐M ☐U ☐NA ☐NE

DETAILS:

1. ANALYTICAL RESULTS CONSISTENT WITH DATA REPORTED ON DMRS: ☒Y ☐N ☐NA ☐NE

2. SAMPLING AND ANALYSES DATA ADEQUATE AND INCLUDE: ☒S ☐M ☐U ☐NA ☐NE

a. DATES AND TIME(S) OF SAMPLING: ☒Y ☐N ☐NA ☐NE

b. EXACT LOCATION(S) OF SAMPLING: ☒Y ☐N ☐NA ☐NE

c. NAME OF INDIVIDUAL PERFORMING SAMPLING: ☒Y ☐N ☐NA ☐NE

d. ANALYTICAL METHODS AND TECHNIQUES: ☒Y ☐N ☐NA ☐NE

e. RESULTS OF CALIBRATIONS: ☒Y ☐N ☐NA ☐NE

f. RESULTS OF ANALYSES: ☒Y ☐N ☐NA ☐NE

g. DATES AND TIMES OF ANALYSES: ☒Y ☐N ☐NA ☐NE

h. NAME OF PERSON(S) PERFORMING ANALYSES: ☒Y ☐N ☐NA ☐NE

3. LABORATORY EQUIPMENT CALIBRATION AND MAINTENANCE RECORDS ADEQUATE: ☒S ☐M ☐U ☐NA ☐NE

4. PLANT RECORDS INCLUDE SCHEDULES, DATES OF EQUIPMENT MAINTENANCE AND REPAIR: ☒S ☐M ☐U ☐NA ☐NE

5. EFFLUENT LOADINGS CALCULATED USING DAILY EFFLUENT FLOW AND DAILY ANALYTICAL DATA: ☒Y ☐N ☐NA ☐NE

SECTION C: OPERATIONS AND MAINTENANCE

TREATMENT FACILITY PROPERLY OPERATED AND MAINTAINED ☒S ☐M ☐U ☐NA ☐NE

DETAILS:

1. TREATMENT UNITS PROPERLY OPERATED: ☒S ☐M ☐U ☐NA ☐NE

2. TREATMENT UNITS PROPERLY MAINTAINED: ☒S ☐M ☐U ☐NA ☐NE

3. STANDBY POWER OR OTHER EQUIVALENT PROVIDED: ☒S ☐M ☐U ☐NA ☐NE

4. ADEQUATE ALARM SYSTEM FOR POWER OR EQUIPMENT FAILURES AVAILABLE: ☒S ☐M ☐U ☐NA ☐NE

5. ALL NEEDED TREATMENT UNITS IN SERVICE: ☒S ☐M ☐U ☐NA ☐NE

6. ADEQUATE NUMBER OF QUALIFIED OPERATORS PROVIDED: ☒S ☐M ☐U ☐NA ☐NE

7. SPARE PARTS AND SUPPLIES INVENTORY MAINTAINED: ☒S ☐M ☐U ☐NA ☐NE

8. OPERATION AND MAINTENANCE MANUAL AVAILABLE: ☐Y ☐N ☒NA ☐NE

9. STANDARD OPERATING PROCEDURES AND SCHEDULES ESTABLISHED: ☒Y ☐N ☐NA ☐NE

10. PROCEDURES FOR EMERGENCY TREATMENT CONTROL ESTABLISHED: ☒Y ☐N ☐NA ☐NE

11. HAVE BYPASSES/OVERFLOWS OCCURRED AT THE PLANT OR IN THE COLLECTION SYSTEM IN THE LAST YEAR: ☒Y ☐N ☐NA ☐NE

12. IF SO, HAS THE REGULATORY AGENCY BEEN NOTIFIED: ☒Y ☐N ☐NA ☐NE

13. HAS CORRECTIVE ACTION BEEN TAKEN TO PREVENT ADDITIONAL BYPASSES/OVERFLOWS: ☒Y ☐N ☐NA ☐NE

14. HAVE ANY HYDRAULIC OVERLOADS OCCURRED AT THE TREATMENT PLANT: ☐Y ☒N ☐NA ☐NE

15. IF SO, DID PERMIT VIOLATIONS OCCUR AS A RESULT: ☐Y ☐N ☒NA ☐NE

SECTION D: SAMPLING	
PERMITTEE SAMPLING MEETS PERMIT REQUIREMENTS	☒ S ☐ M ☐ U ☐ NA ☐ NE
DETAILS:	
1. SAMPLES TAKEN AT SITE(S) SPECIFIED IN PERMIT:	☒ Y ☐ N ☐ NA ☐ NE
2. LOCATIONS ADEQUATE FOR REPRESENTATIVE SAMPLES:	☒ Y ☐ N ☐ NA ☐ NE
3. FLOW PROPORTIONED SAMPLES OBTAINED WHEN REQUIRED BY PERMIT:	☒ Y ☐ N ☐ NA ☐ NE
4. SAMPLING AND ANALYSES COMPLETED ON PARAMETERS SPECIFIED IN PERMIT:	☒ Y ☐ N ☐ NA ☐ NE
5. SAMPLING AND ANALYSES PERFORMED AT FREQUENCY SPECIFIED IN PERMIT:	☒ Y ☐ N ☐ NA ☐ NE
6. SAMPLE COLLECTION PROCEDURES ADEQUATE:	☒ Y ☐ N ☐ NA ☐ NE
a. SAMPLES REFRIGERATED DURING COMPOSITING:	☒ Y ☐ N ☐ NA ☐ NE
b. PROPER PRESERVATION TECHNIQUES USED:	☒ Y ☐ N ☐ NA ☐ NE
c. CONTAINERS AND SAMPLE HOLDING TIMES CONFORM TO 40 CFR 136:	☒ Y ☐ N ☐ NA ☐ NE
7. IF MONITORING IS PERFORMED MORE OFTEN THAN REQUIRED ARE RESULTS REPORTED ON THE DMR:	☒ Y ☐ N ☐ NA ☐ NE
SECTION E: FLOW MEASUREMENT	
PERMITTEE FLOW MEASUREMENT MEETS PERMIT REQUIREMENTS	☒ S ☐ M ☐ U ☐ NA ☐ NE
DETAILS:	
1. PRIMARY FLOW MEASUREMENT DEVICE PROPERLY INSTALLED AND MAINTAINED: <u>Yes</u> TYPE OF DEVICE: <u>4 ft. Rectangular weir with end contractions</u>	☒ Y ☐ N ☐ NA ☐ NE
2. FLOW MEASURED AT EACH OUTFALL AS REQUIRED:	☒ Y ☐ N ☐ NA ☐ NE
3. SECONDARY INSTRUMENTS (TOTALIZERS, RECORDERS, ETC.) PROPERLY OPERATED AND MAINTAINED: <u>Siemens Hydrometer</u>	☒ Y ☐ N ☐ NA ☐ NE
4. CALIBRATION FREQUENCY ADEQUATE:	☒ Y ☐ N ☐ NA ☐ NE
5. RECORDS MAINTAINED OF CALIBRATION PROCEDURES:	☒ Y ☐ N ☐ NA ☐ NE
6. CALIBRATION CHECKS DONE TO ASSURE CONTINUED COMPLIANCE:	☒ Y ☐ N ☐ NA ☐ NE
7. FLOW ENTERING DEVICE WELL DISTRIBUTED ACROSS THE CHANNEL AND FREE OF TURBULENCE:	☒ Y ☐ N ☐ NA ☐ NE
8. FLOW MEASUREMENT EQUIPMENT ADEQUATE TO HANDLE EXPECTED RANGE OF FLOW RATES:	☒ Y ☐ N ☐ NA ☐ NE
9. HEAD MEASURED AT PROPER LOCATION:	☒ Y ☐ N ☐ NA ☐ NE
SECTION F: LABORATORY	
PERMITTEE LABORATORY PROCEDURES MEET PERMIT REQUIREMENTS	☒ S ☐ M ☐ U ☐ NA ☐ NE
DETAILS:	
1. EPA APPROVED ANALYTICAL PROCEDURES USED (40 CFR 136.3 FOR LIQUIDS, 503.8(B) FOR SLUDGES) :	☒ Y ☐ N ☐ NA ☐ NE
2. IF ALTERNATIVE ANALYTICAL PROCEDURES ARE USED, PROPER APPROVAL HAS BEEN OBTAINED:	☒ Y ☐ N ☐ NA ☐ NE
3. SATISFACTORY CALIBRATION AND MAINTENANCE OF INSTRUMENTS AND EQUIPMENT:	☒ Y ☐ N ☐ NA ☐ NE
4. QUALITY CONTROL PROCEDURES ADEQUATE:	☒ Y ☐ N ☐ NA ☐ NE
5. DUPLICATE SAMPLES ARE ANALYZED $\geq 10\%$ OF THE TIME:	☒ Y ☐ N ☐ NA ☐ NE
6. SPIKED SAMPLES ARE ANALYZED $\geq 10\%$ OF THE TIME:	☒ Y ☐ N ☐ NA ☐ NE
7. COMMERCIAL LABORATORY USED:	☒ Y ☐ N ☐ NA ☐ NE
a. LAB NAME: <u>Arkansas Analytical, Inc.</u>	
b. LAB ADDRESS: <u>Little Rock, AR</u>	
c. PARAMETERS PERFORMED: <u>WET Testing</u>	
8. BIOMONITORING PROCEDURES ADEQUATE:	☒ Y ☐ N ☐ NA ☐ NE
a. PROPER ORGANISMS USED:	☒ Y ☐ N ☐ NA ☐ NE
b. PROPER DILUTION SERIES FOLLOWED:	☒ Y ☐ N ☐ NA ☐ NE
c. PROPER TEST METHODS AND DURATION:	☒ Y ☐ N ☐ NA ☐ NE
d. RETESTS AND/OR TRE PERFORMED AS REQUIRED:	☒ Y ☐ N ☐ NA ☐ NE

SECTION G: EFFLUENT/RECEIVING WATERS OBSERVATIONS							
BASED ON VISUAL OBSERVATIONS ONLY						☒ S ☐ M ☐ U ☐ NA ☐ NE	
DETAILS:							
OUTFALL #:	OIL SHEEN	GREASE	TURBIDITY	VISIBLE FOAM	FLOATING SOLIDS	COLOR	OTHER
001	None	None	Low	None	None	Clear	--
SECTION H: SLUDGE DISPOSAL							
SLUDGE DISPOSAL MEETS PERMIT REQUIREMENTS						☒ S ☐ M ☐ U ☐ NA ☐ NE	
DETAILS: <u>Sludge is digested and used for biosolids</u>							
1. SLUDGE MANAGEMENT ADEQUATE TO MAINTAIN EFFLUENT QUALITY:						☒ S ☐ M ☐ U ☐ NA ☐ NE	
2. SLUDGE RECORDS MAINTAINED AS REQUIRED BY 40 CFR 503:						☒ S ☐ M ☐ U ☐ NA ☐ NE	
3. FOR LAND APPLIED SLUDGE, TYPE OF LAND APPLIED TO: (E.G., FOREST, AGRICULTURAL, PUBLIC CONTACT SITE):							
SECTION I: SAMPLING INSPECTION PROCEDURES							
SAMPLE RESULTS WITHIN PERMIT REQUIREMENTS						☐ S ☐ M ☐ U ☒ NA ☐ NE	
DETAILS:							
1. SAMPLES OBTAINED THIS INSPECTION:						☐ Y ☐ N ☒ NA ☐ NE	
2. TYPE OF SAMPLE: ☐ GRAB:___ ☐ COMPOSITE:___ METHOD:___ FREQUENCY:___							
3. SAMPLES PRESERVED:						☐ Y ☐ N ☒ NA ☐ NE	
4. FLOW PROPORTIONED SAMPLES OBTAINED:						☐ Y ☐ N ☒ NA ☐ NE	
5. SAMPLE OBTAINED FROM FACILITY'S SAMPLING DEVICE:						☐ Y ☐ N ☒ NA ☐ NE	
6. SAMPLE REPRESENTATIVE OF VOLUME AND NATURE OF DISCHARGE:						☐ Y ☐ N ☒ NA ☐ NE	
7. SAMPLE SPLIT WITH PERMITTEE:						☐ Y ☐ N ☒ NA ☐ NE	
8. CHAIN-OF-CUSTODY PROCEDURES EMPLOYED:						☐ Y ☐ N ☒ NA ☐ NE	
9. SAMPLES COLLECTED IN ACCORDANCE WITH PERMIT:						☐ Y ☐ N ☒ NA ☐ NE	
SECTION J: STORM WATER POLLUTION PREVENTION PLAN							
STORM WATER MANAGEMENT MEETS PERMIT REQUIREMENTS						☐ S ☐ M ☐ U ☒ NA ☐ NE	
DETAILS:							
1. SWPPP UPDATED AS NEEDED:___ DATE OF LAST UPDATE:___						☐ Y ☐ N ☒ NA ☐ NE	
2. SITE MAP INCLUDING ALL DISCHARGES AND SURFACE WATERS:						☐ Y ☐ N ☒ NA ☐ NE	
3. POLLUTION PREVENTION TEAM IDENTIFIED:						☐ Y ☐ N ☒ NA ☐ NE	
4. POLLUTION PREVENTION TEAM PROPERLY TRAINED:						☐ Y ☐ N ☒ NA ☐ NE	
5. LIST OF POTENTIAL POLLUTANT SOURCES:						☐ Y ☐ N ☒ NA ☐ NE	
6. LIST OF POTENTIAL SOURCES AND PAST SPILLS AND LEAKS:						☐ Y ☐ N ☒ NA ☐ NE	
7. ALL NON-STORM WATER DISCHARGES ARE AUTHORIZED:						☐ Y ☐ N ☒ NA ☐ NE	
8. LIST OF STRUCTURAL BMPS:						☐ Y ☐ N ☒ NA ☐ NE	
9. LIST OF NON-STRUCTURAL BMPS:						☐ Y ☐ N ☒ NA ☐ NE	
10. BMPS PROPERLY OPERATED AND MAINTAINED:						☐ Y ☐ N ☒ NA ☐ NE	
11. INSPECTIONS CONDUCTED AS REQUIRED:						☐ Y ☐ N ☒ NA ☐ NE	

FLOW CALCULATION SHEET

Date:	5/22/2025	Time:	11:20	
Head in Inches:		Feet:	0.56	
Type & Size of Primary Flow Measurement Device: 4 ft. Rectangular weir with end contractions				
Name & Model of Secondary Flow Measurement Device:			Siemens Hydrometer	
Date of last Calibration of Secondary Flow Device:			7/25/2024	
Recorded Flow at Date & Time Listed Above:			3.494	(Facility Flow Meter)
Calculated Flow at Date & Time Listed Above:			3.506	
(Flow is calculated using flow charts in: ISCO Open Channel Flow Measurement Handbook-5 th Edition)				
% Error =	Recorded Value	-	Calculated Value	X 100
	Calculated Value			
% Error =	3.494	-	3.506	X 100
	3.506			
% Error =	-0.012	X 100		
	3.506			
% Error =	-0.0034	X 100		
% Error =	-0.34	%		
Comments:	<u>Within +/- 10%</u>			

DMR Calculation Check

Reporting Period:	From	<u>2025</u>	<u>03</u>	<u>01</u>	To	<u>2025</u>	<u>03</u>	<u>31</u>
		Year	Month	Day		Year	Month	Day

Parameter Checked: TSS

	Loading Mass	Concentration	
	Mo. Avg. - lbs/day	Mo. Avg. - mg/l	7-day Avg. - mg/l
Reported Value:	<u>203.2</u>	<u>5.6</u>	<u>7.5</u>
Calculated Value:	<u>203.2</u>	<u>5.6</u>	<u>7.5</u>
Permit Value:	750.0	15.0	22.5

If calculated value does not equal reported value, explain: Equal

DMR Calculation Check

Reporting Period:	From	<u>2024</u>	<u>09</u>	<u>01</u>	To	<u>2024</u>	<u>09</u>	<u>30</u>
		Year	Month	Day		Year	Month	Day

Parameter Checked: NH4-N

	Loading Mass Mo. Avg. - lbs/day	Concentration Monthly Mo. Avg. - mg/l	7-day Avg. - mg/l
Reported Value:	3.6	0.12	0.27
Calculated Value:	3.6	0.12	0.27
Permit Value:	105.0	2.1	5.2

If calculated value does not equal reported value, explain: Equal

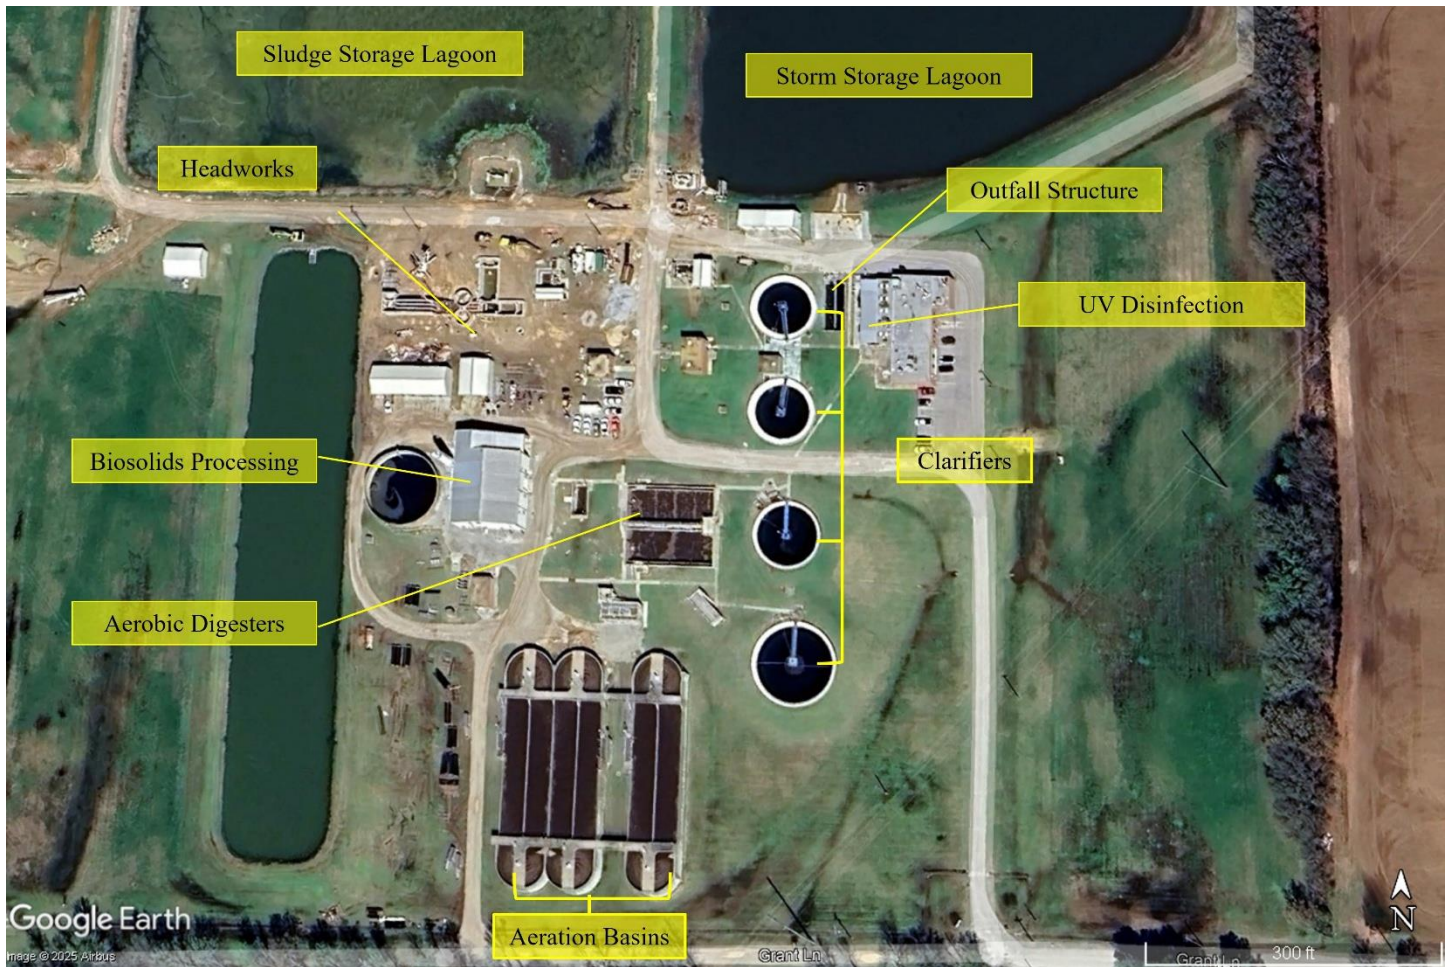


Figure 1. Google Earth image of the Paragould Municipal Utilities (PMU) WWTP with labels to identify the different areas of treatment.

Office of Water Quality Photographic Evidence Sheet				
Location:	Paragould Municipal Utilities			
Photographer:	Sarah Frasher	Date:	5/22/2025	Time:
Witness:	Walter Kincade and Sarah Harrod			Photo #:
Description:	View of the newly constructed headworks.			
				
Photographer:	Sarah Frasher	Date:	5/22/2025	Time:
Witness:	Walter Kincade and Sarah Harrod			Photo #:
Description:	View of the automated bar screen to the headworks.			
				

Office of Water Quality Photographic Evidence Sheet			
Location:	Paragould Municipal Utilities		
Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:13
Photo #:	3		
Description:	View of the holding cell for rainfall events.		
			
Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:07
Photo #:	4		
Description:	View of the roll-off dumpsters. Note the amount of grit collected.		
			

Office of Water Quality Photographic Evidence Sheet				
Location:	Paragould Municipal Utilities			
Photographer:	Sarah Frasher	Date:	5/22/2025	Time:
Witness:	Walter Kincade and Sarah Harrod		Photo #:	5
Description:	View of the influent entering the wastewater treatment plant.			
				
Photographer:	Sarah Frasher	Date:	5/22/2025	Time:
Witness:	Walter Kincade and Sarah Harrod		Photo #:	6
Description:	View of the aeration basin.			
				

Office of Water Quality Photographic Evidence Sheet			
Location:	Paragould Municipal Utilities		
Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:19
		Photo #:	7
Description:	View of the mixing wheel of the aeration basin.		



Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:24
		Photo #:	8
Description:	View of the aerobic digesters.		



Office of Water Quality Photographic Evidence Sheet

Location:	Paragould Municipal Utilities		
Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:26
		Photo #:	9
Description:	Overview of the biosolids building.		



Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:30
		Photo #:	10
Description:	View of the inside of the biosolids building. Note the repairs to the screw press.		



Office of Water Quality Photographic Evidence Sheet			
Location:	Paragould Municipal Utilities		
Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:31
Description:	View of the biosolids processing.		



Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:38
Description:	View of the return water from the biosolids processing.		




Office of Water Quality Photographic Evidence Sheet

Location:	Paragould Municipal Utilities		
Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:42
Description:	View of the clarifier.	Photo #:	13



Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:39
Description:	View of weir from clarifier.	Photo #:	14

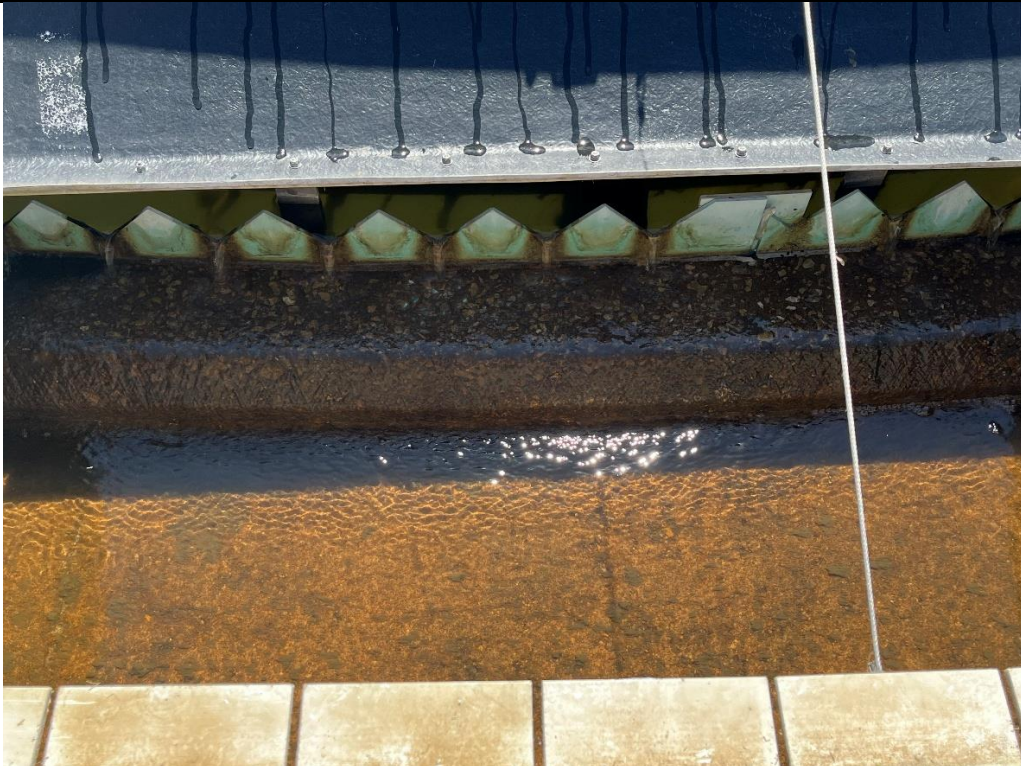

Office of Water Quality Photographic Evidence Sheet

Location:	Paragould Municipal Utilities		
Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:43
Description:	View of the UV system.		



Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:52
Description:	Close-up view of the UV disinfection system.		



Office of Water Quality Photographic Evidence Sheet

Location:	Paragould Municipal Utilities		
Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:52
		Photo #:	17
Description:	View of the UV disinfection in the water.		



Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:46
		Photo #:	18
Description:	View of the rectangular weir.		



Office of Water Quality Photographic Evidence Sheet			
Location:	Paragould Municipal Utilities		
Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:47
Photo #:	19		
Description:	View of the staff gauge at the outfall structure.		
			

Photographer:	Sarah Frasher	Date:	5/22/2025
Witness:	Walter Kincade and Sarah Harrod	Time:	10:46
Photo #:	20		
Description:	View of the thermometer used in the sampler. Note the temperature lower than 4°C.		
			