



CITY OF HOT SPRINGS

Utilities Department

780 Adams Street

Hot Springs, Arkansas 71901

April 14, 2025

Sent via Email

Leslie Allen-Daniel
Enforcement Analyst – Water Division
Arkansas Energy & Environment – Environmental Quality
5301 Northshore Drive
North Little Rock, AR 72118-5317

**RE: City of Hot Springs Utilities
Permit No. AR0033880 / AFIN 26-00145
Progress Report – Hot Springs Creek Pump Station**

Dear Ms. Allen-Daniel,

Hot Springs Utilities has taken delivery of the second 300-hp Cornell pump. The City is taking bids for installation of the pump station improvements. Construction will be completed this summer.

Two SSO events occurred near the Hot Springs Creek Pumps Stations: one at MH 1866 and one at MH 3728. Both events occurred on the same day and affected the same body of water. Lab results, CodeRed and Cleanup activities are attached.

Should you have any questions, please contact me at mledbetter@cityhs.net.

Sincerely,

Monty Ledbetter
Utilities Director

Attachments: Lab Results; Documentation of Public Notice Signage; Environmental Cleanup Activities

cc: **City of Hot Springs** - Bill Burrough, City Manager; Denny McPhate, Deputy City Manager; Harold Mauldin, Wastewater Facilities Operations Manager; Todd Piller, Capital Project Manager;
Consultants - Craig Johnson, Crist
Arkansas Energy & Environment Division of Environmental Quality – Richard Healey

MARCH SSO REPORT for Manhole 1866 and Manhole 3728

Hot Springs Creek

Manhole 1866
 Overflow Date: 3/4/2025
 End Date: 3/4/2025
 Cause: Rainfall, Equipment
 Discharge: Approximately 30,000 gallons discharged to Hot Springs Creek
 Actions Taken: Hydro Cleaned, Environmental Cleanup
 Code Red Issued: 3/4/2025
 Code Red Cancelled: 3/9/2025

362 Fontana Road

Manhole 3728
 Overflow Date: 3/4/2025
 End Date: 3/4/2025
 Cause: Rainfall, Equipment
 Discharge: Approximately 9,000 gallons discharged to Hot Springs Creek
 Actions Taken: Hydro Cleaned, Environmental Cleanup
 Code Red Issued: 3/4/2025
 Code Red Cancelled: 3/9/2025

107 Forest View Court

Lab Results cover both SSO events

Sample Date:	3/4/2025	Sample Date:	3/6/2025	Sample Date:	3/7/2025
Site No.	E. coli (cfu)	Site No.	E. coli (cfu)	Site No.	E. coli (cfu)
1	>2419.6	2	228.2	2	410.6
		3	191.8	3	207.5
		4	163.8	4	344.8

Code Red Signage



Site 1 Signage placed 3/4/2025



Site 2 Signage placed 3/4/2025



Site 1 Signage removed 3/9/2025




Site 1 Signage removed 3/9/2025

Environmental Cleanup Activities – Manhole 1866 – March 5, 2025



MH 1866 Before cleanup

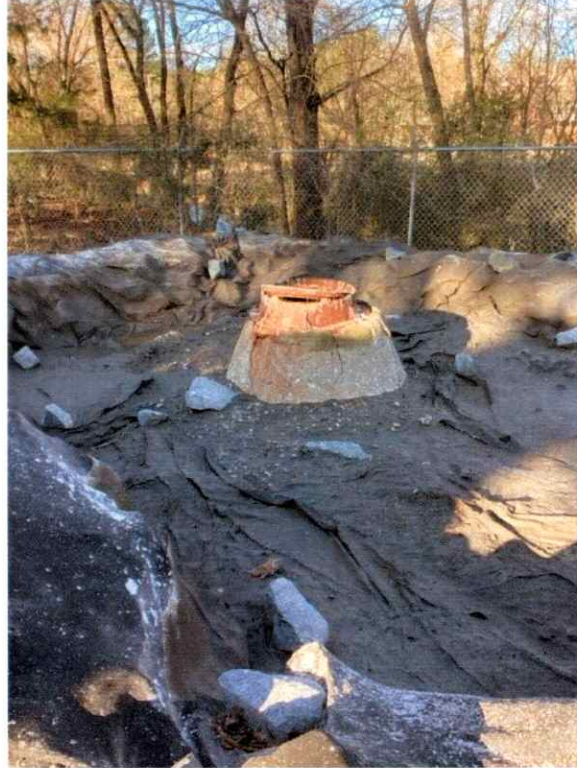

MH 1866 Before cleanup



MH 1866 During cleanup



MH 1866 During cleanup

Environmental Cleanup Activities – Manhole 1866 – March 5, 2025



MH 1866 During cleanup



MH 1866 After cleanup

Environmental Cleanup Activities – Manhole 3728 – March 5, 2025




MH 3728 Before cleanup



MH 3728 During cleanup



MH 3728 During cleanup

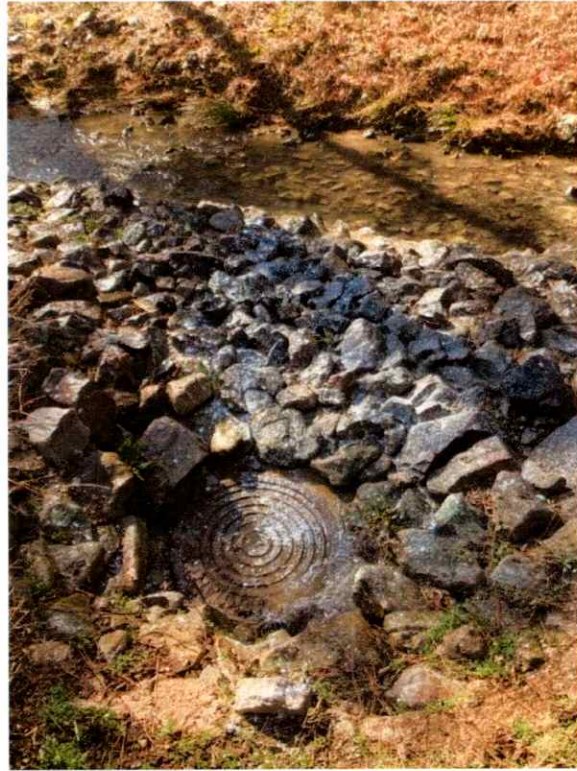

MH 3728 After cleanup