



CITY OF HOT SPRINGS

Davidson Wastewater Treatment Plant

320 Davidson Drive Hot Springs, Arkansas 71901

Phone: (501) 621-5041

SSO ANALYSIS REPORT

Date of overflow event: 2/12/25

Location of event: Hot Springs Creek (Manhole 1865& 1866)


Sample collection date: 2/24/25

Samples analyzed for: E. Coli

ANALYSIS RESULTS

<u>Site #</u>	<u>Time collected</u>	<u>Results</u>
Site 2:	1309	E. Coli – 2.0 cfu per 100mls
Site 3:	1313	E. Coli – 5.1 cfu per 100m
Site 4:	1316	E. Coli – 5.2 cfu per 100mls

Results for samples taken on 2/21/25 & 2/24/25 were below the EPA recommended 630 cfu's per 100 mls at site #2, site #3, and site #4. No further testing is needed.

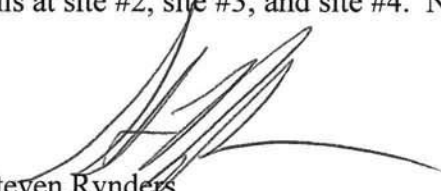

Steven Rynders
Lab Technician

Harold Mauldin
Facilities Operations Manager
City of Hot Springs